FIG. 1

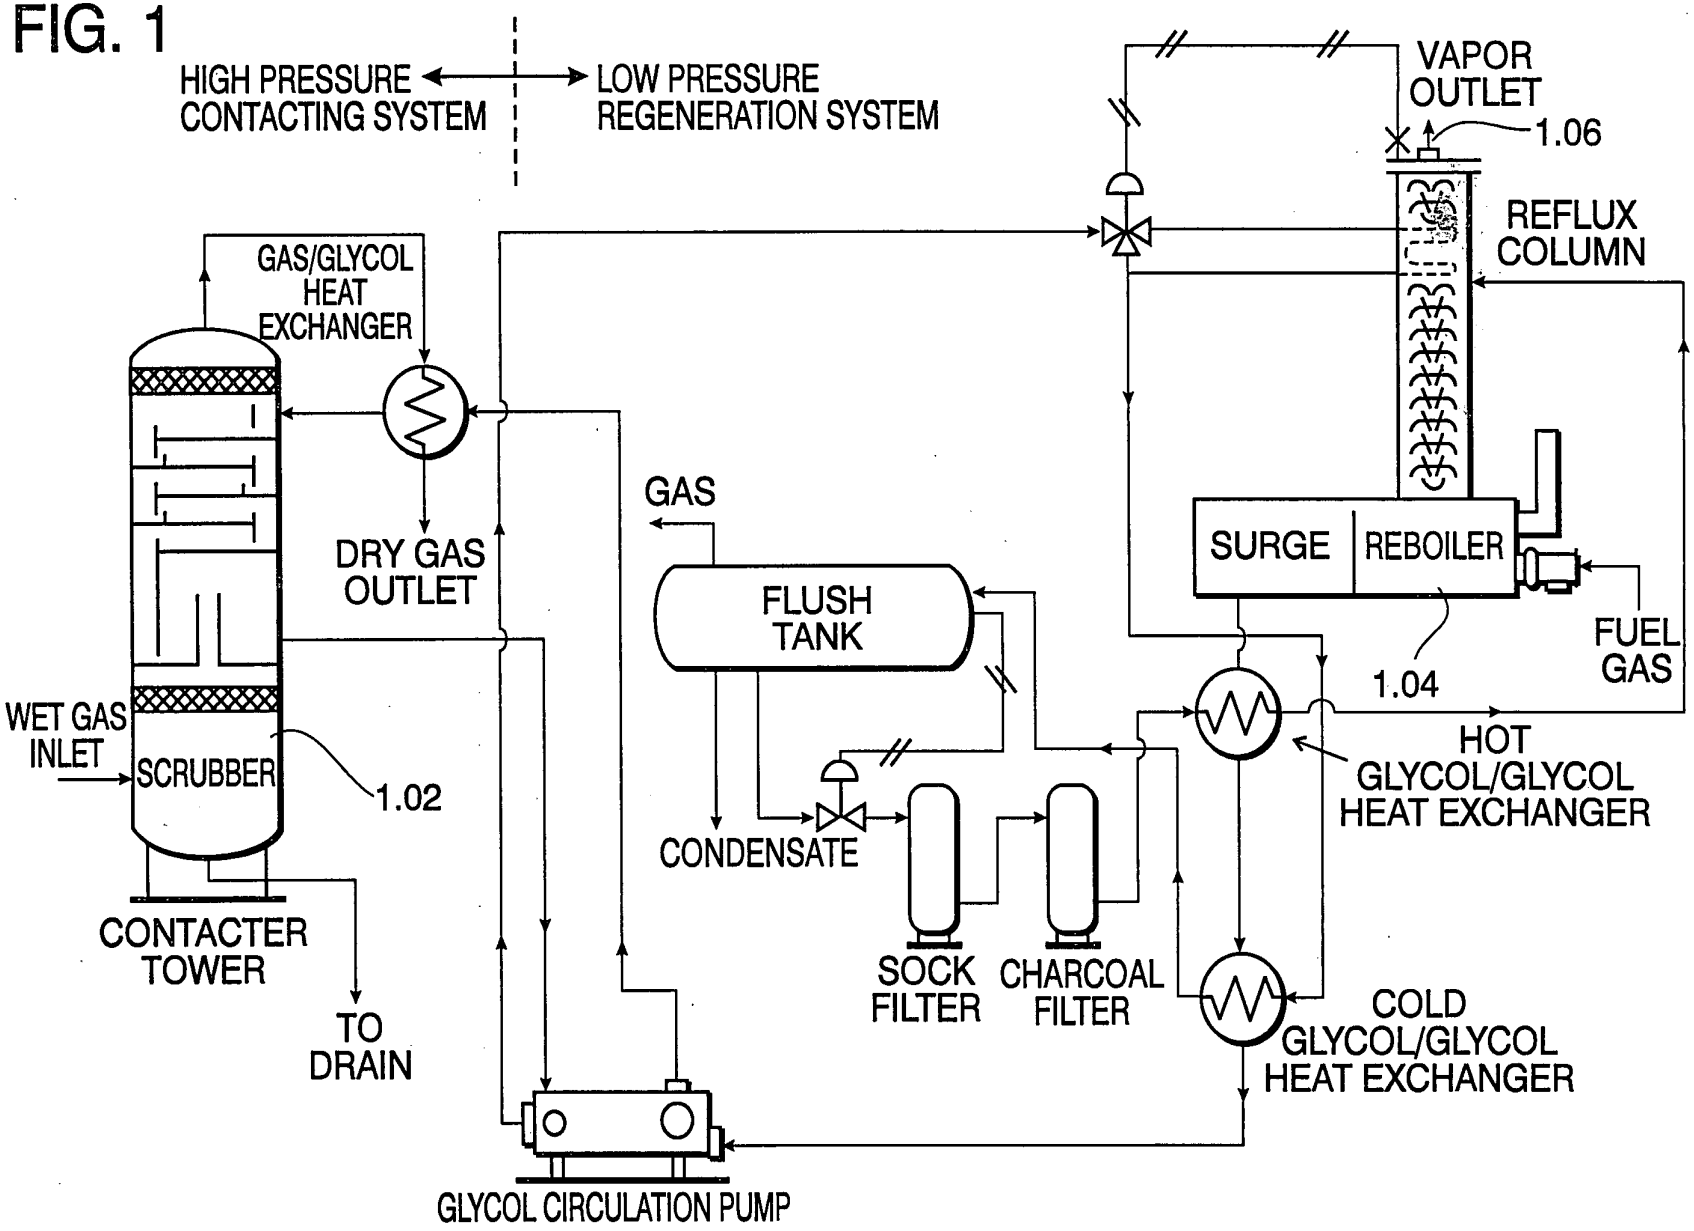
HIGH PRESSURE CONTACTING SYSTEM
LOW PRESSURE REGENERATION SYSTEM
VAPOR OUTLET
1.06
REFLUX COLUMN
GAS/GLYCOL HEAT EXCHANGER
DRY GAS OUTLET
GAS
FLUSH TANK
SURGE
REBOILER
FUEL GAS
1.04
WET GAS INLET
SCRUBBER
1.02
HOT GLYCOL/GLYCOL HEAT EXCHANGER
CONDENSATE
SOCK FILTER
CHARCOAL FILTER
CONTACTER TOWER
TO DRAIN
COLD GLYCOL/GLYCOL HEAT EXCHANGER
GLYCOL CIRCULATION PUMP

FIG. 2

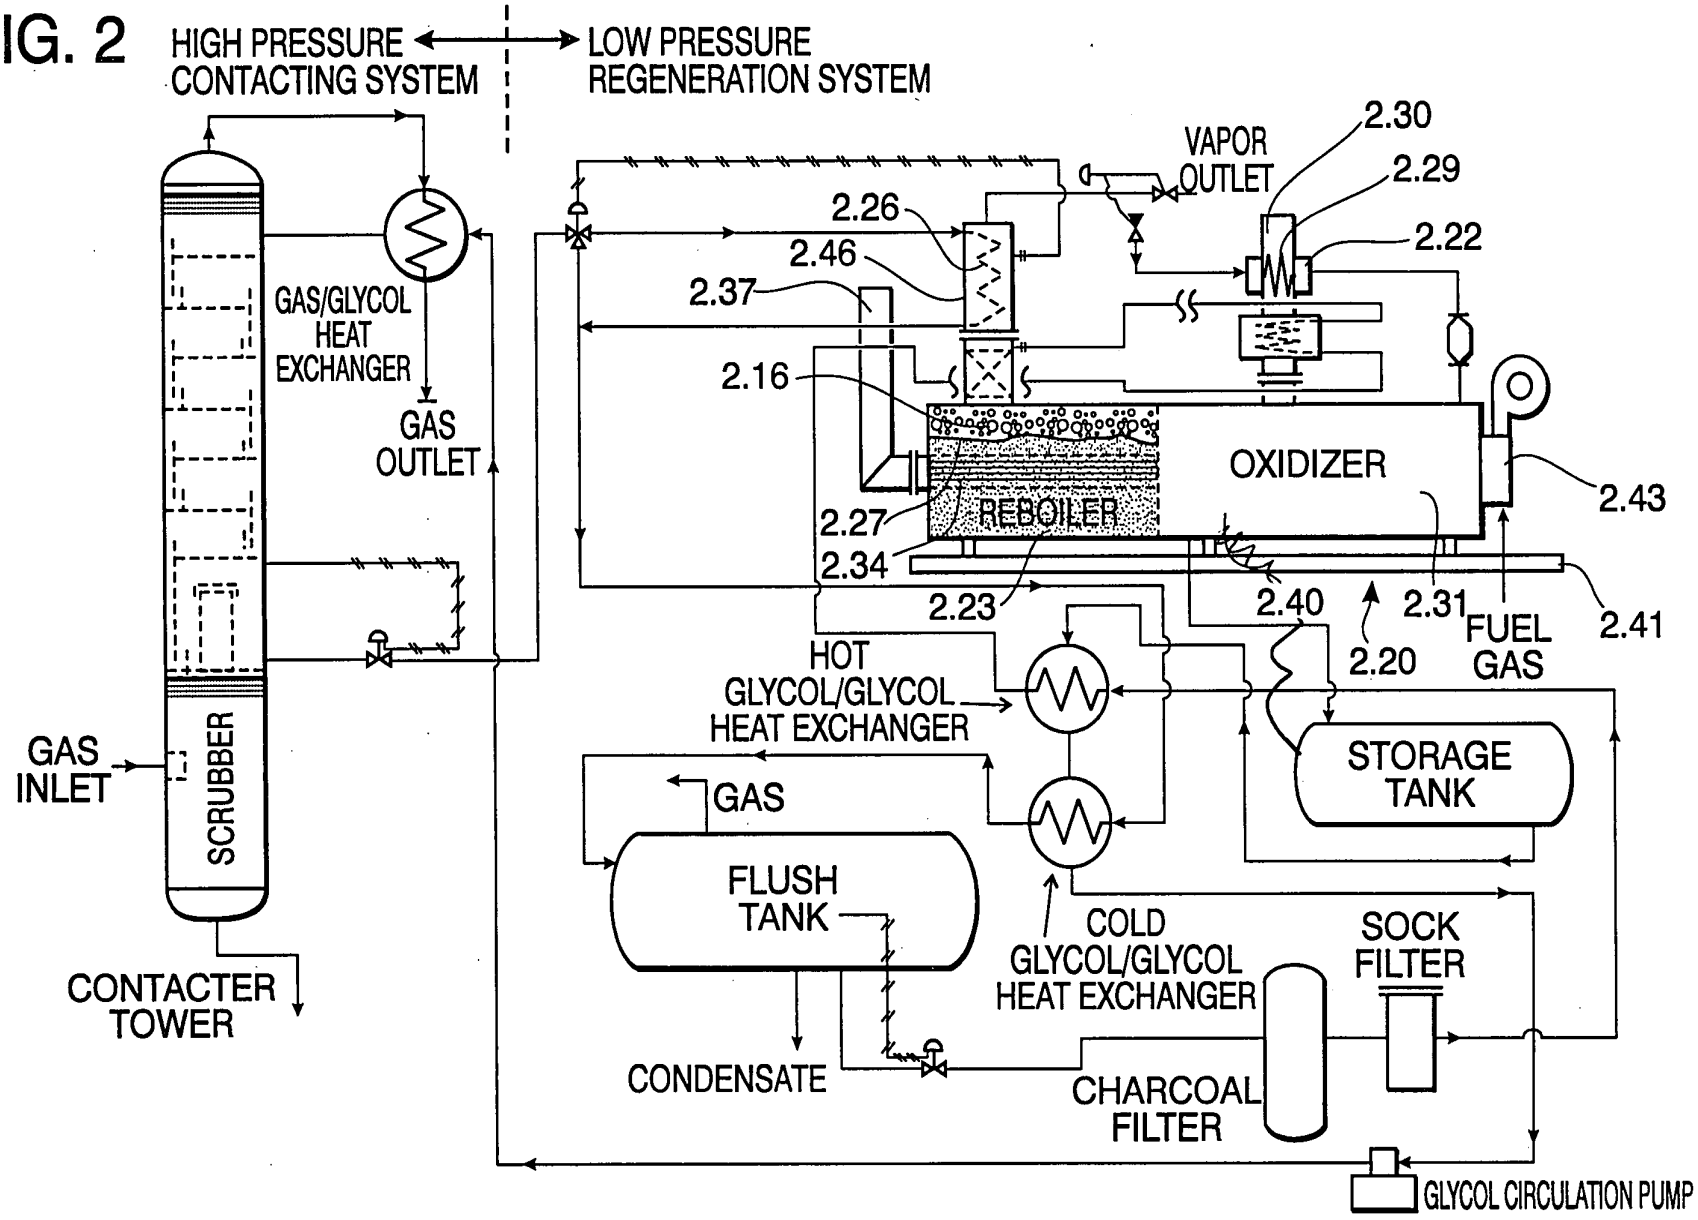
HIGH PRESSURE CONTACTING SYSTEM
LOW PRESSURE REGENERATION SYSTEM
VAPOR OUTLET
2.30
2.29
2.22
2.26
2.46
2.37
2.16
GAS/GLYCOL HEAT EXCHANGER
GAS OUTLET
OXIDIZER
REBOILER
2.43
2.27
2.34
2.23
2.40
2.31
FUEL GAS
2.41
2.20
HOT GLYCOL/GLYCOL HEAT EXCHANGER
STORAGE TANK
GAS INLET
SCRUBBER
GAS
FLUSH TANK
COLD GLYCOL/GLYCOL HEAT EXCHANGER
SOCK FILTER
CONTACTER TOWER
CONDENSATE
CHARCOAL FILTER
GLYCOL CIRCULATION PUMP

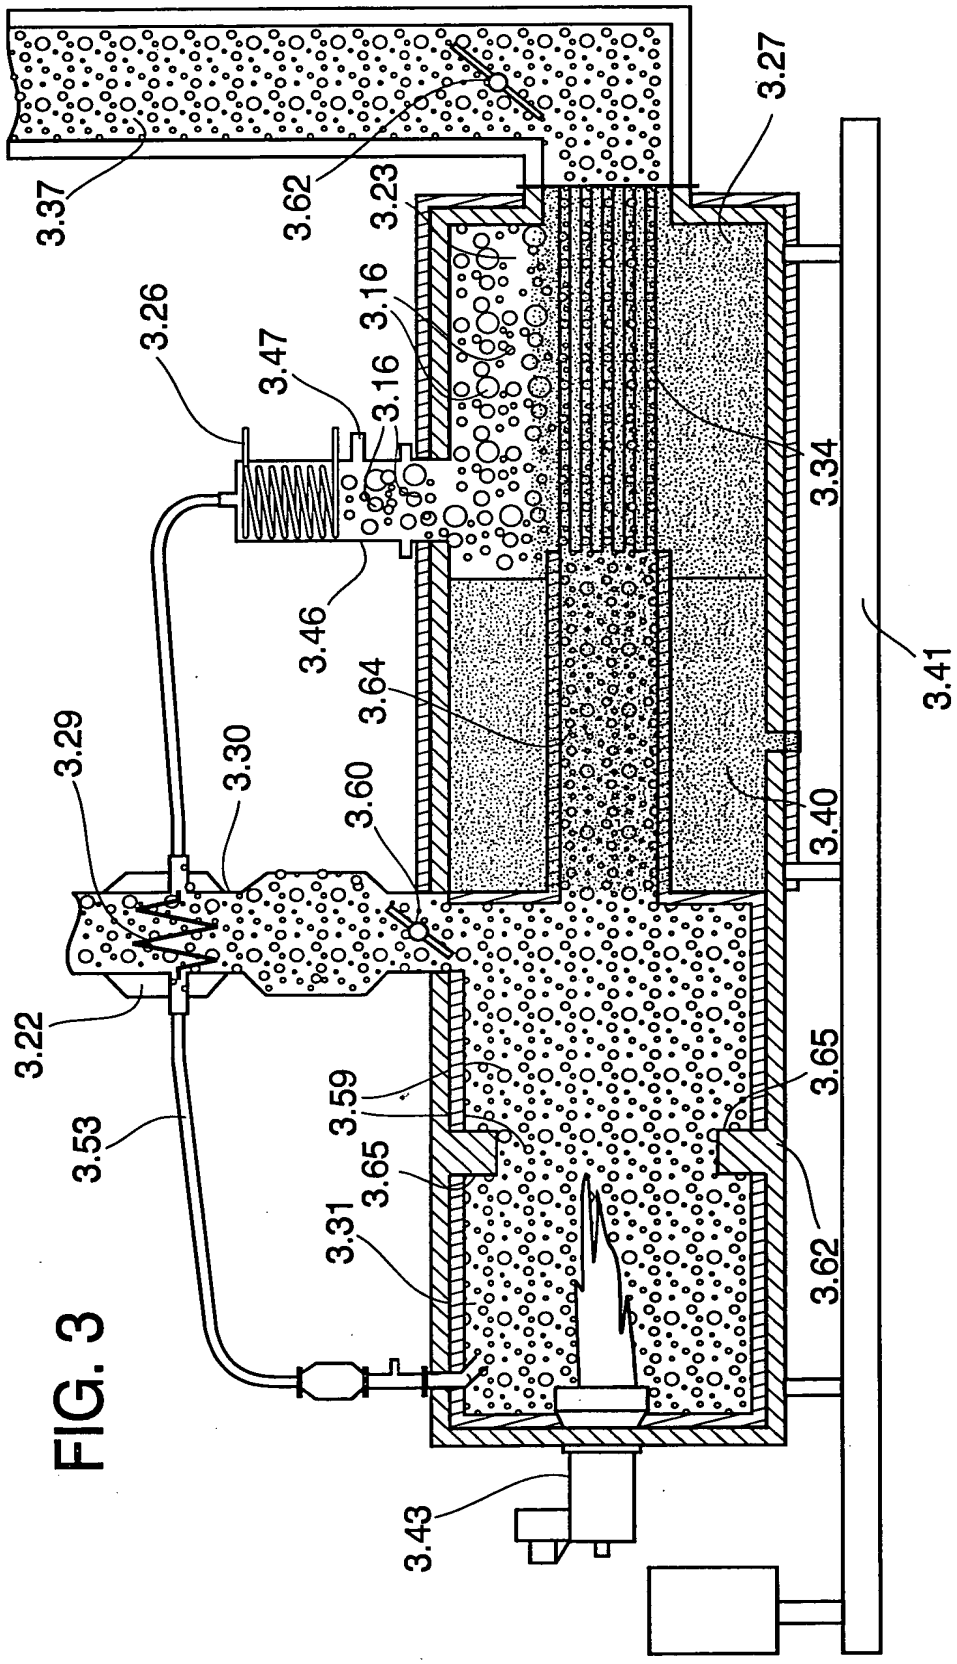
3.37
3.62
3.23
3.27
3.26
3.47
3.16
3.16
3.34
3.46
3.64
3.41
3.29
3.30
3.60
3.40
3.22
3.59
3.65
3.53
3.65
3.31
3.62
3.43

FIG. 3

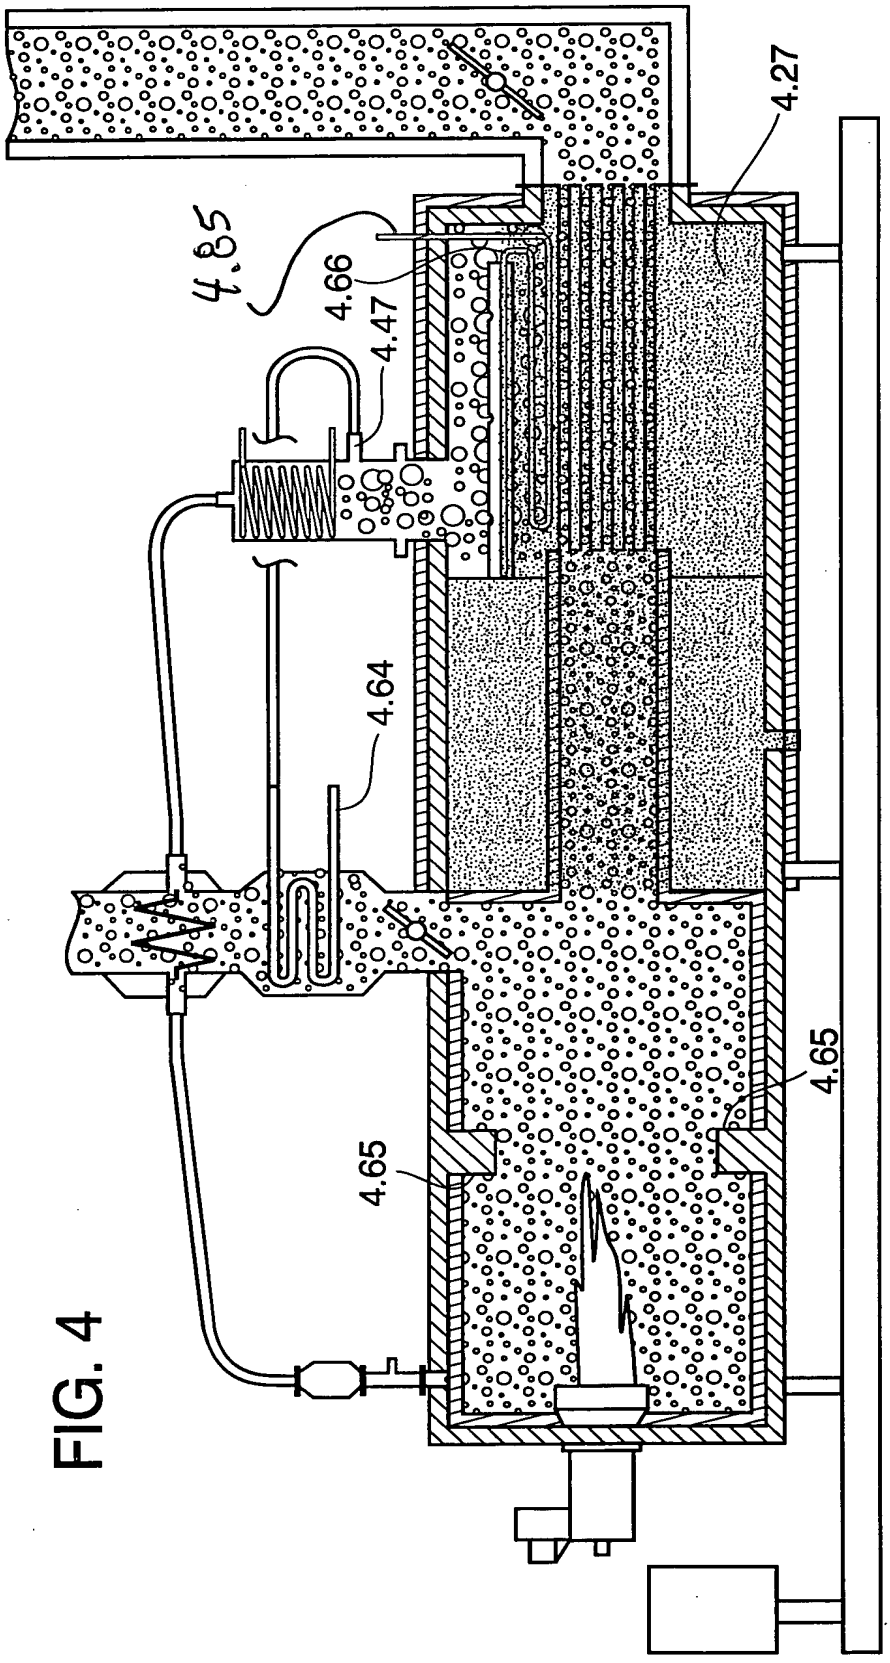

FIG. 4

FIG. 5

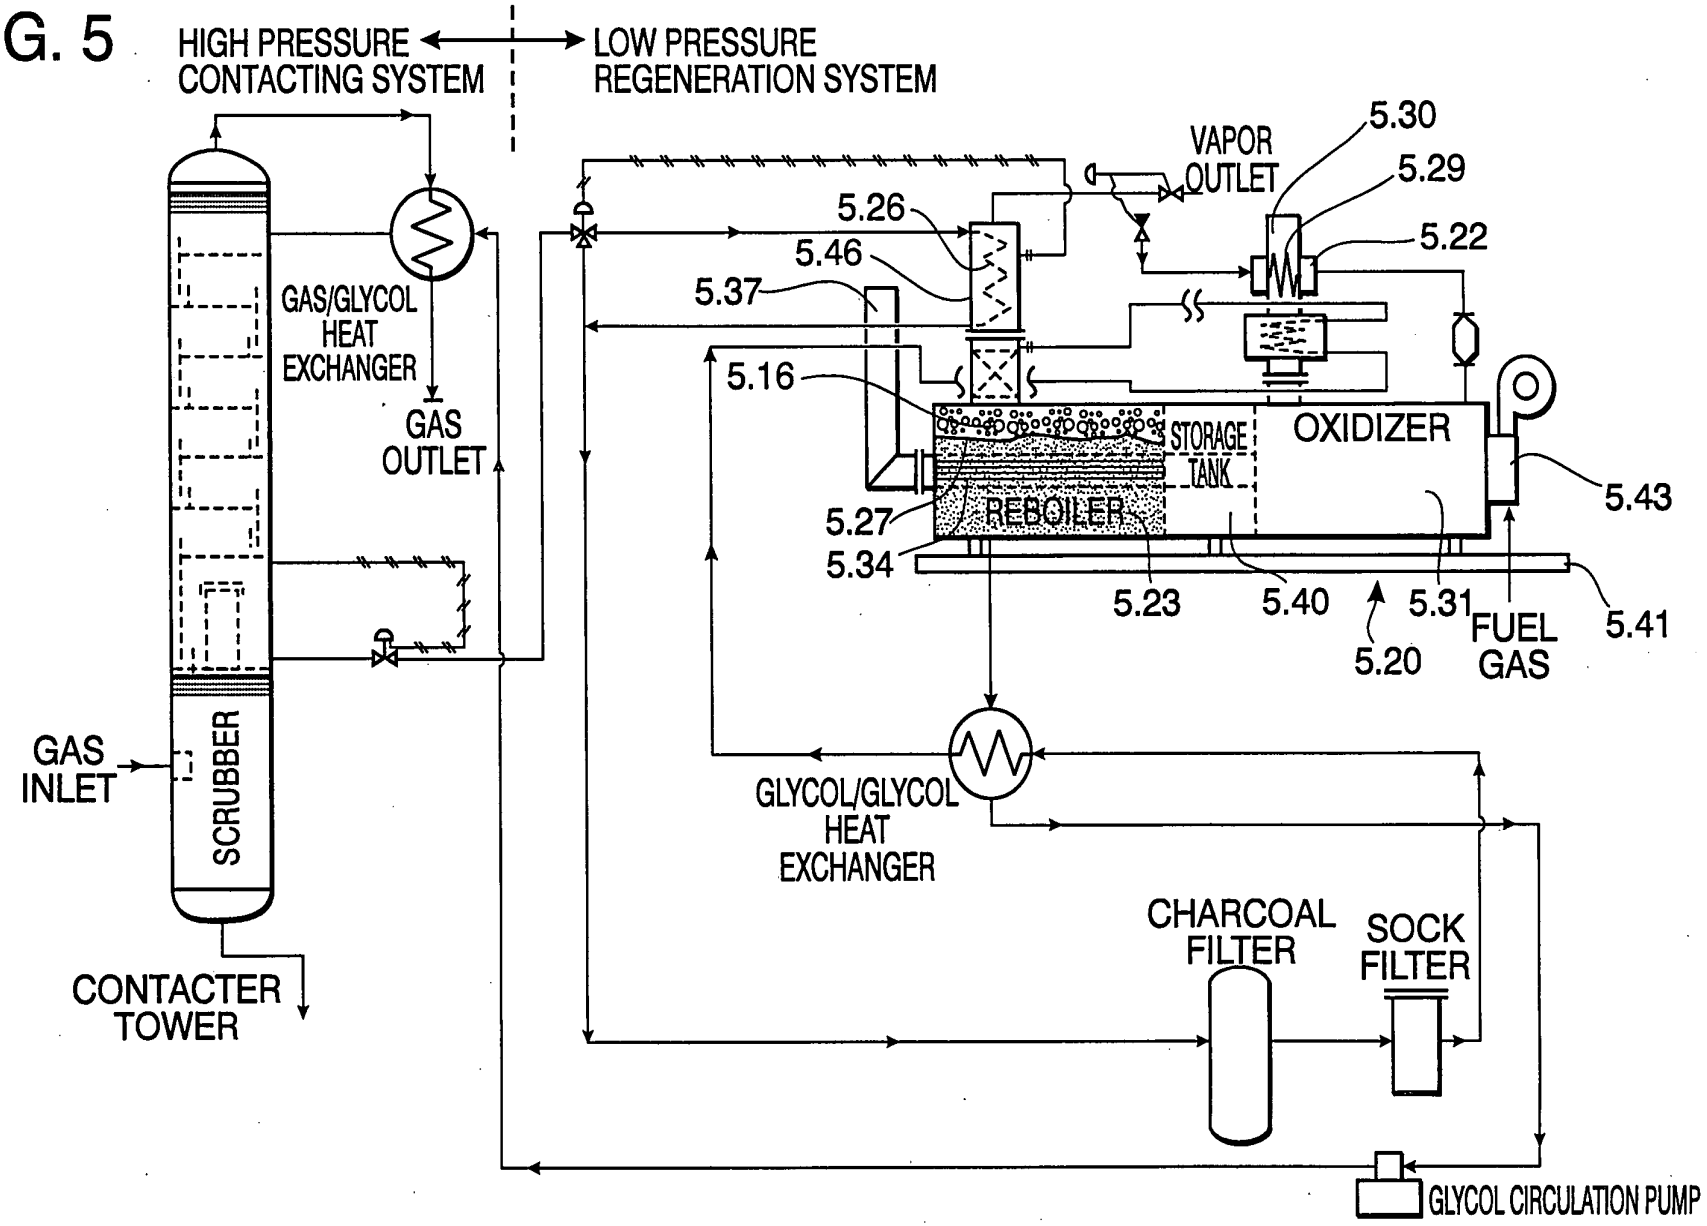
HIGH PRESSURE CONTACTING SYSTEM
LOW PRESSURE REGENERATION SYSTEM
VAPOR OUTLET
5.30
5.29
5.22
5.26
5.46
5.37
5.16
GAS/GLYCOL HEAT EXCHANGER
GAS OUTLET
STORAGE TANK
OXIDIZER
REBOILER
5.43
5.27
5.34
5.23
5.40
5.31
5.20
FUEL GAS
5.41
GAS INLET
SCRUBBER
GLYCOL/GLYCOL HEAT EXCHANGER
CHARCOAL FILTER
SOCK FILTER
CONTACTER TOWER
GLYCOL CIRCULATION PUMP